


- CPS Energy's Recommended Substation Site
- - - Potential Transmission Line

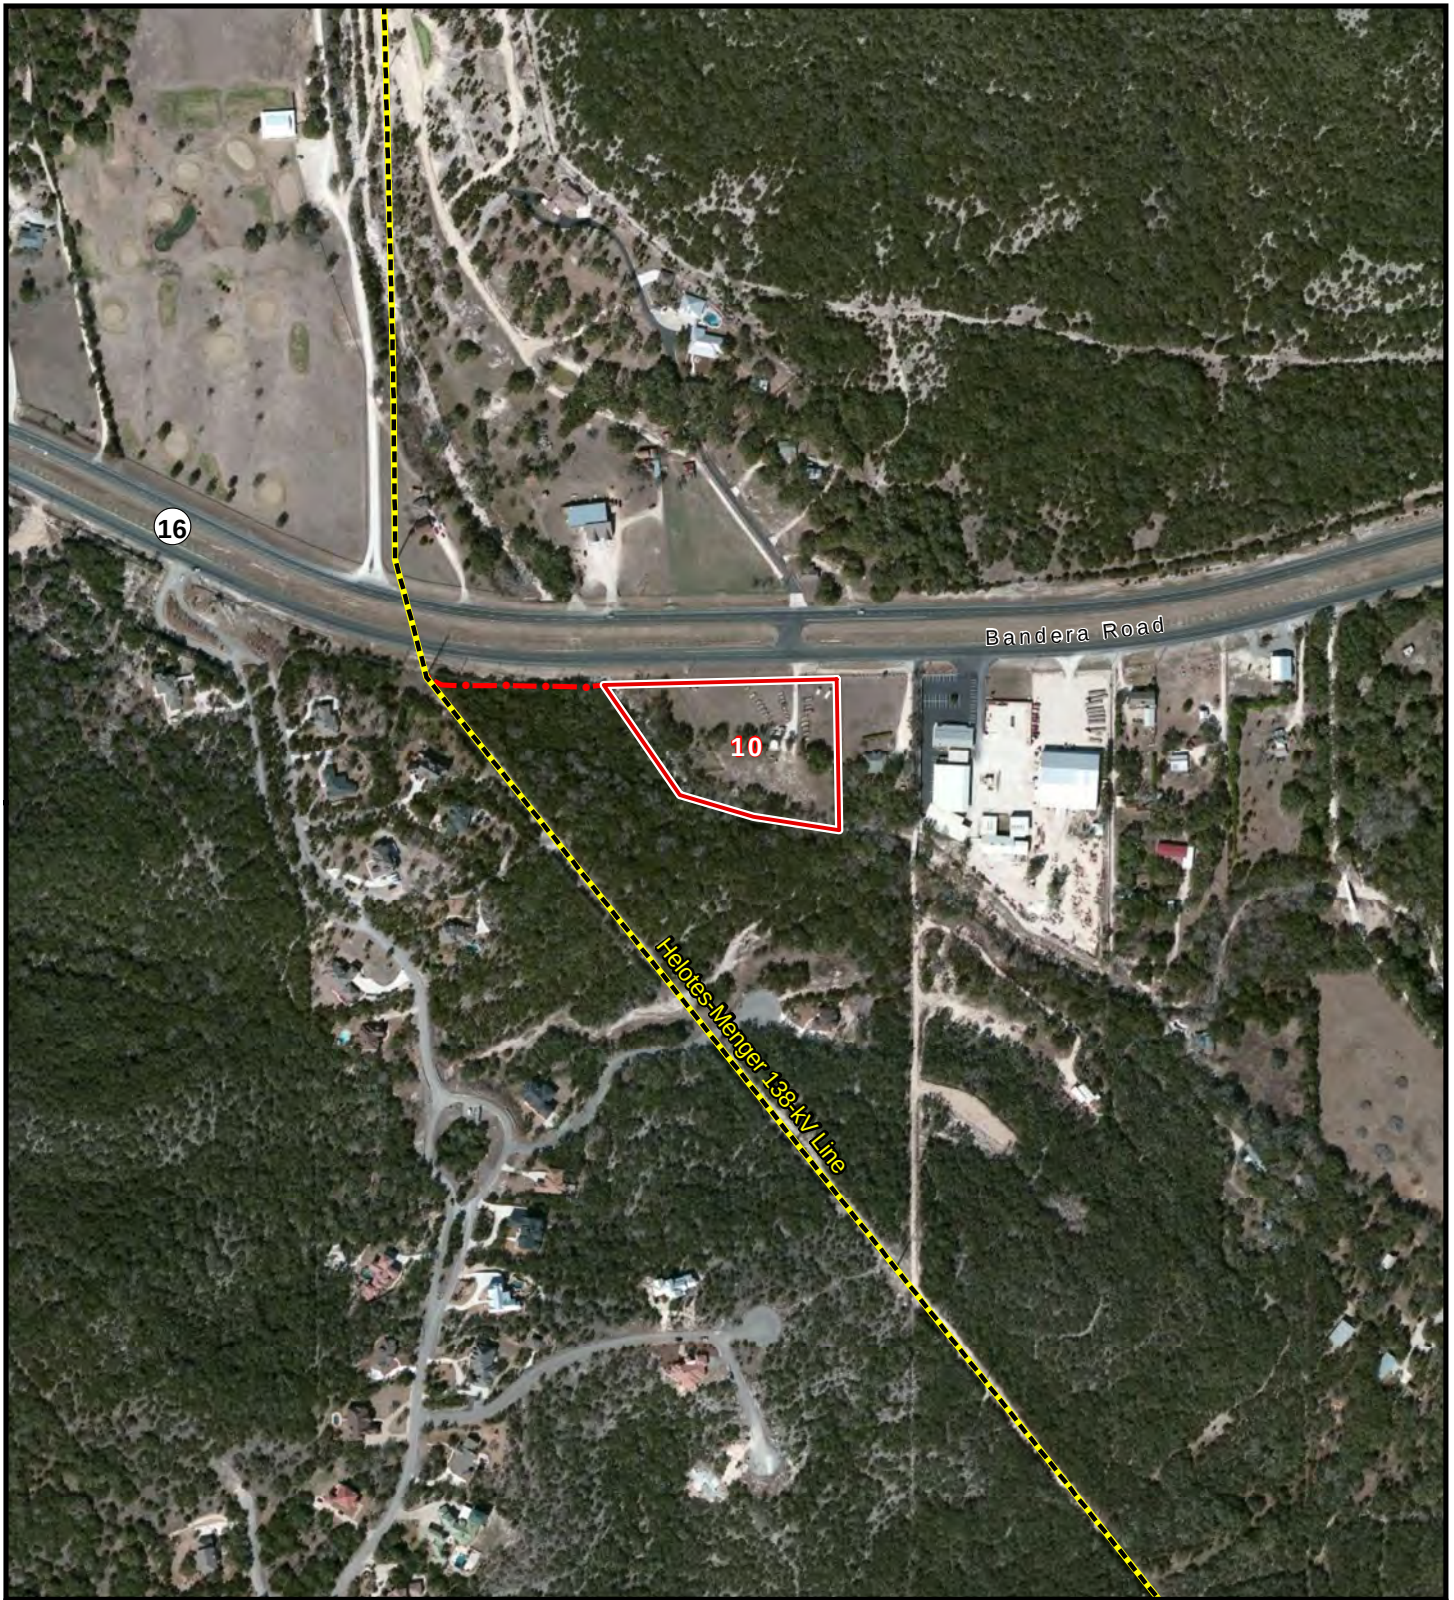

0 500
 Feet

ATKINS

CPS ENERGY'S APPROVED SITE
 RANCHTOWN SUBSTATION PROJECT